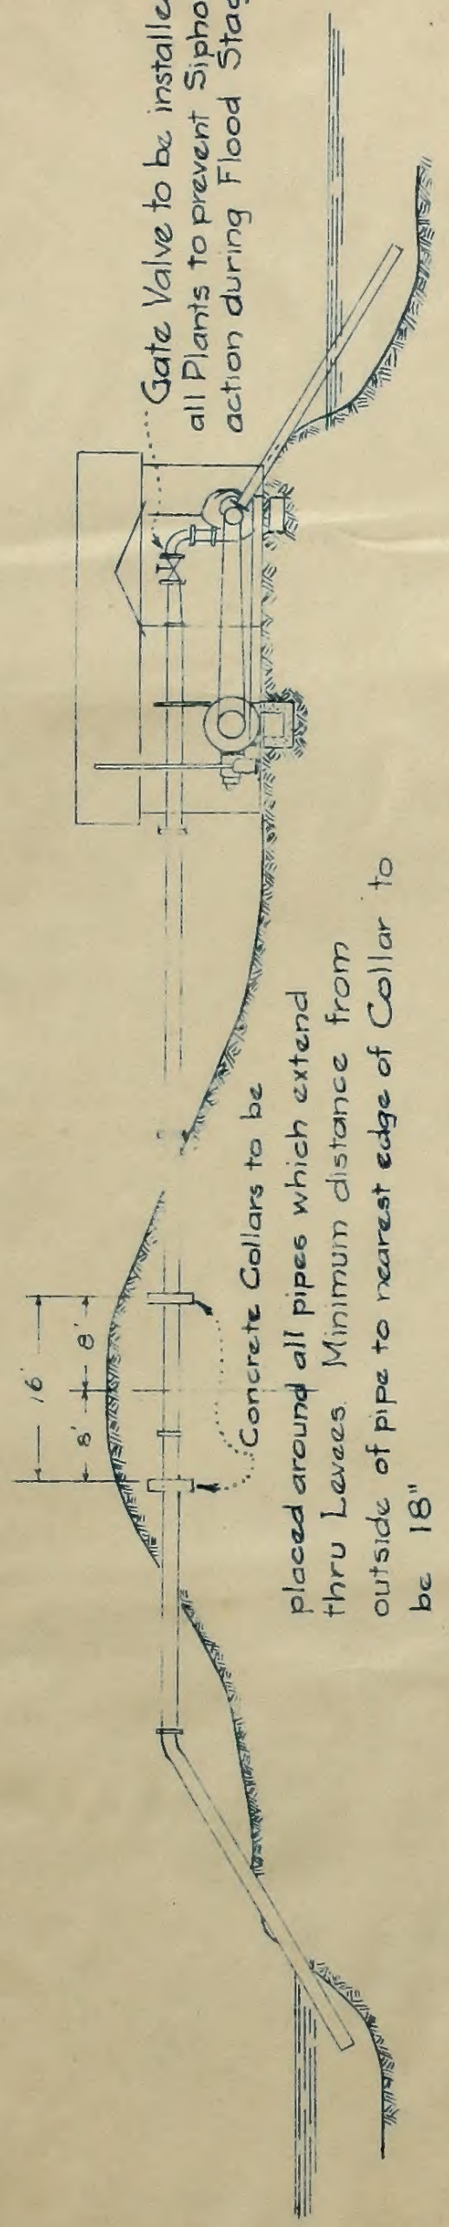
Gate Valve to be installed at all Plants to prevent Siphon action during Flood Stages
Concrete Collars to be placed around all pipes which extend thru Levees. Minimum distance from outside of pipe to nearest edge of Collar to be 18"
16'
8'
8'
San Joaquin River

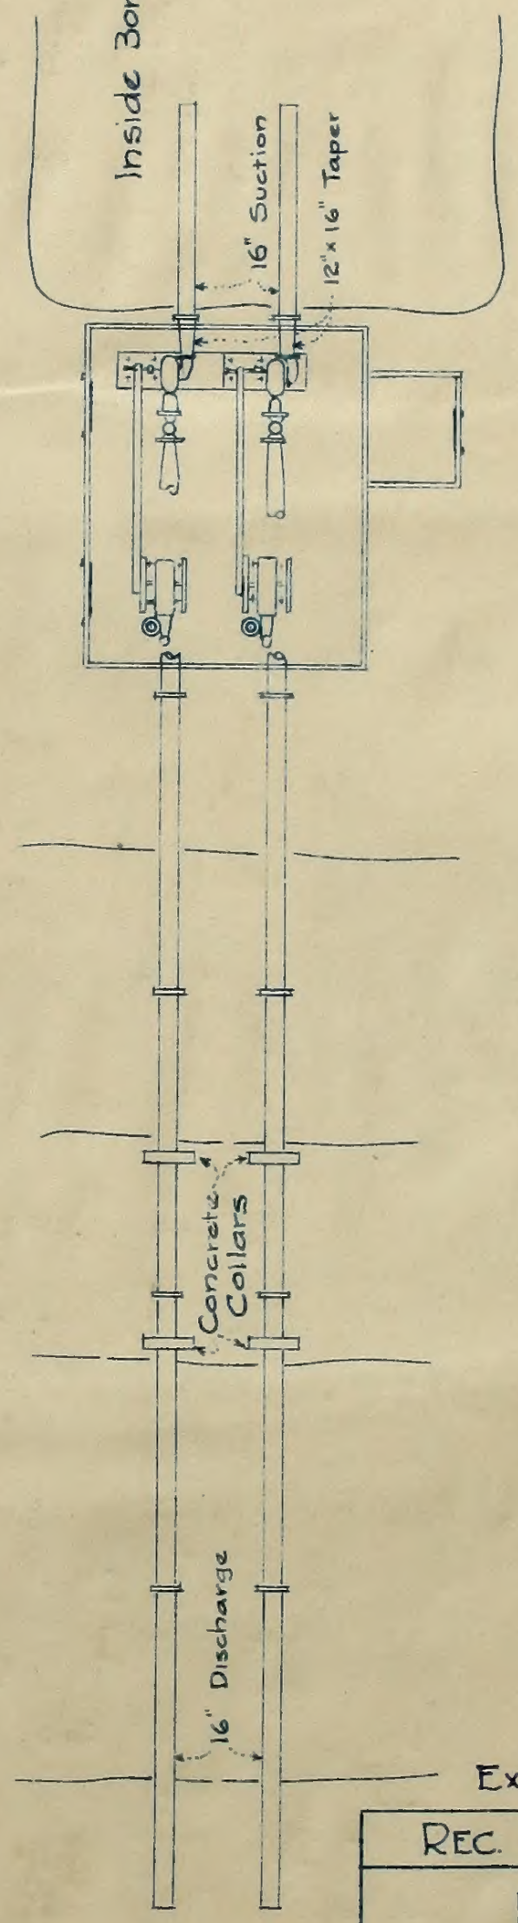

Exhibit "O"

REC. DIST. NO 2064

PROPOSED
MAIN DRAINAGE
PLANT

Dr.	Ckd	Scale 1" = 20
Tr. ED	App.	March 1926
Harmon S. Bonte Engr		D-217'